

GENERAL NOTES :

1. ALL ELECTRICAL WORKS COMPLIED IN ACCORDANCE WITH THE PLAN AND SPECIFICATIONS, THE APPLICABLE PROVISIONS OF THE LATEST EDITION OF THE PHILIPPINE ELECTRICAL CODE (PEC), THE RULES AND REGULATIONS OF LOCAL ENFORCING AUTHORITY AND THE REQUIREMENTS OF THE LOCAL POWER COMPANY.
- THE ELECTRICAL WORKS WAS DONE UNDER THE IMMEDIATE SUPERVISION OF A DUTY REGISTERED ELECTRICAL ENGINEER.
2. THE ELECTRICAL SERVICE POWER IS 1 - PHASE, 2 - WIRE, 230V AC, 60Hz
3. WIRING METHOD WAS FOLLOWED:
- a. FEEDERS AND RISERS

b. BRANCHING POWER & RESERVE

c. BRANCH CIRCUIT / & AUXILIARY
- INTERMEDIATE METALLIC CONDUIT

- POLYETHYLENE CHLORIDE CONDUIT SCHED. 40
4. ALL WIRES ARE COPPER & THERMOPLASTIC INSULATED TYPE "THW", THE MINIMUM SIZE OF WIRE FOR POWER & LIGHTING CIRCUIT HOMERUN 3.5mm2 INSULATED FOR 600 VOLTS, RACEWAY -15mm. dia. TRADE/NOMINAL SIZE.
5. ALL OUTLET BOXES ARE GALVANIZED GAGE No. 16 DEEP TYPE WITH FACTORY KNOCKOUTS.
6. ALL MATERIALS USED ARE BRAND NEW AND APPROVED TYPE FOR THE PARTICULAR LOCATION AND PURPOSE OF USAGE.
7. GROUNDING SYSTEM PROVIDED TO ALL LIGHTING AND POWER CIRCUIT AS PER PHILIPPINE ELECTRICAL CODE REQUIREMENT.
8. MOUNTING HEIGHT OF WIRING DEVICES ARE:
- a. LIGHT SWITCH

b. CONVENIENCE OUTLET

c. PANEL BOARD
- 1.20 m. ABOVE FIN. F.L.R. LINE

- 0.30 m. ABOVE FIN. F.L.R. LINE


- 1.80 m. ABOVE FIN. F.L.R. LINE

LOAD SCHEDULE


PANELBOARD : LP				MAIN : 40AFT, 100AF, 2P, 240V			
CCT. NO.	DESCRIPTION	VA LOAD	CIRCUIT BREAKER			WIRE & CONDUIT SIZE	
			VOLT	POLE	AF		
1	CONVENIENCE OUTLET 4 x 180W	720	230	2	20	50	3-3.5mm2 THW IN 15mm. dia. C
2	LIGHTS AND FAN	1200	230	2	20	50	3-3.5mm2 THW IN 15mm. dia. C
3	SPARE	1500	230	2	20	50	3-3.5mm2 THW IN 15mm. dia. C
4	TOTAL	3420	230	2	20	50	_____
FEEDER : 2 - 5.5mm2 THW IN 20mm. dia. NSC PROTECTION : 40AFT, 50AF, 2P, 240V IL = $\frac{3420}{230V}$ = 15 A							

LEGEND :


SYMBOL	DESCRIPTION
	1 x 40 WATT FLUORESCENT LAMP
	2 x 40 WATT FLUORESCENT LAMP
	PROPOSED CEILING FAN
	FAN CONTROL SWITCH
	THREE GANG DEVICE SWITCH
	RACEWAY CONDUIT CONCEALED IN CEILING
	RACEWAY CONDUIT CONCEALED IN FLOORING
	PANELBOARD
	DUPLEX CONVENIENCE OUTLET
	CIRCUIT BREAKER
	ELECTRIC SERVICE METER
	SERVICE ENTRANCE

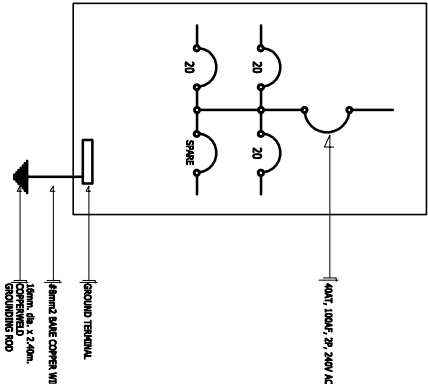

SINGLE LINE DIAGRAM
NOT TO SCALE

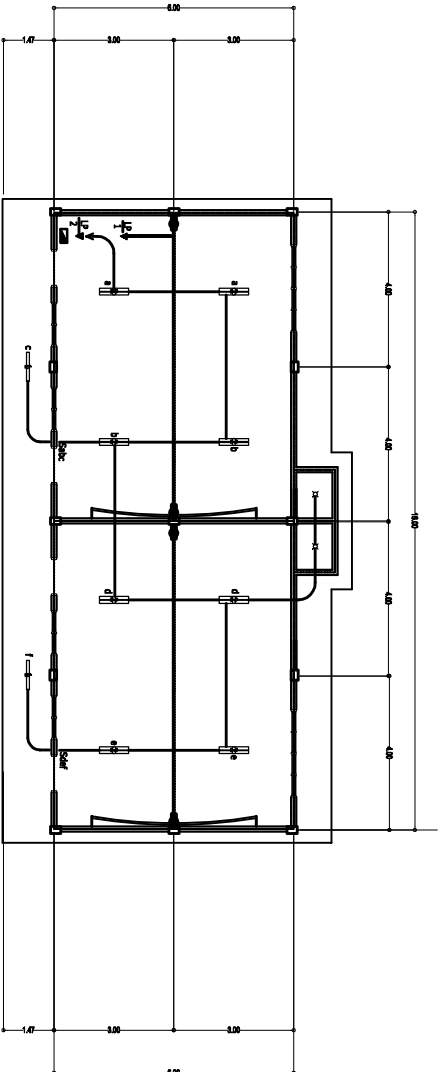

ELECTRICAL LAY-OUT
SCALE 1 : 100 M.



DEPARTMENT OF EDUCATION

DIVISION OF MISAMIS ORIENTAL

4, Viterbi Street, Cagayan de Oro City

PROJECT TITLE :

REPAIR / REHABILITATION OF ONE STOREY TWO (2) CLASSROOMS MULTI-PURPOSE TYPE WITH ATTACHED CR

ADDRESS : MAWAS ELEMENTARY SCHOOL

DIVISION : MISAMIS ORIENTAL

PREPARED BY:

ENGR. SANDY L. SIMO, CE

RECOMMENDING APPROVAL:

RUDY O. MAGDUGO

APPROVED:

CHERRY MAE L. LIMBAGO, Ph.D., CESO V

SHEET CONTENTS :

POWER LAY-OUT
LIGHTING LAY-OUT
SINGLE LINE DIAGRAM
GENERAL NOTES :
LOAD SCHEDULE
LEGEND :

SHEET NUMBER

03 of 03